

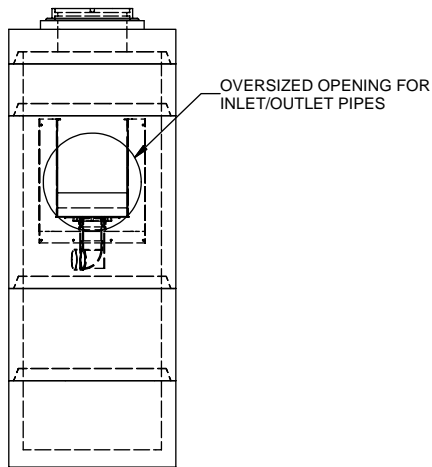


This CADD file is for the purpose of specifying stormwater treatment equipment to be furnished by CONTECH Stormwater Solutions and may only be transferred to other documents exactly as provided by CONTECH Stormwater Solutions. Title block information, **excluding** the CONTECH Stormwater Solutions logo and the VortSentry HS Stormwater Treatment System designation and patent number, may be deleted if necessary. Revisions to any part of this CADD file without prior coordination with CONTECH Stormwater Solutions shall be considered unauthorized use of proprietary information.

THE VORTSENTRY HS CONTROL SECTION SHALL BE STENCILED WITH THE CONTECH STORMWATER SOLUTIONS NAME AND LOGO. PIPE OPENINGS SHALL BE STENCILED "INLET" OR "OUTLET" AS APPROPRIATE

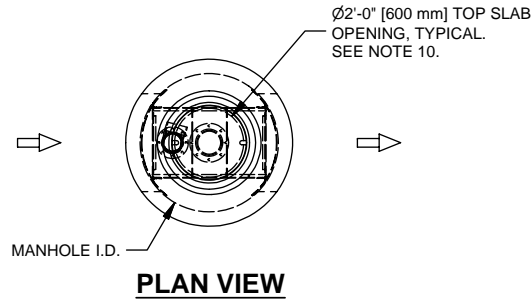


**LEFT SIDE VIEW**

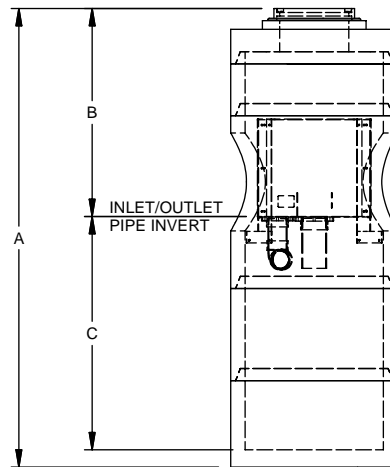

**ELEVATION VIEW**

**NOTES:**

1. STORMWATER TREATMENT SYSTEM (SWTS) SHALL REMOVE 80% OF A SEDIMENT GRADATION WITH AN AVERAGE PARTICLE SIZE OF 240 MICRONS AT THE DESIGNATED TREATMENT FLOW RATE LISTED IN THE TABLE FOR EACH CORRESPONDING MODEL.
2. SWTS REMOVAL EFFICIENCY CLAIM SHALL BE CORROBORATED BY FULL SCALE LABORATORY TEST PERFORMANCE DATA.
3. SWTS MAINTENANCE RECOMMENDATIONS SHALL BE SUPPORTED BY FULL SCALE WASH-OUT TESTING.
4. SWTS SHALL PROVIDE INTERNAL BYPASS OF FLOWS THAT EXCEED THE TREATMENT FLOW RATE.
5. SWTS MAXIMUM HYDRAULIC CAPACITY MAY VARY DEPENDING UPON THE INLET PIPE DIAMETER, MATERIAL AND SLOPE.
6. SWTS INVERTS IN AND OUT SHALL BE AT THE SAME ELEVATION.
7. PIPE SIZE MAY BE SMALLER THAN THE MAXIMUM PIPE SHOWN ON THE TABLE; SEE SITE PLAN FOR PIPE SIZE.
8. MINIMUM RIM TO INVERT DISTANCE MAY BE REDUCED DEPENDING UPON ACTUAL PIPE DIAMETER. CONTACT CONTECH STORMWATER SOLUTIONS FOR SITE SPECIFIC INFORMATION.
9. PURCHASER SHALL NOT BE RESPONSIBLE FOR ASSEMBLY OF INTERNAL COMPONENTS
10. MANHOLE FRAMES AND COVERS SUPPLIED WITH SYSTEM, NOT INSTALLED. SWTS MAY ALSO HAVE A GRATED INLET COVER (NOT SHOWN).
11. PURCHASER TO PREPARE EXCAVATION AND PROVIDE LIFTING EQUIPMENT.
12. VORTSENTRY HS BY CONTECH STORMWATER SOLUTIONS; PORTLAND, OR (800) 548-4667; SCARBOROUGH, ME (877) 907-8676; LINTHICUM, MD (866) 740-3318.

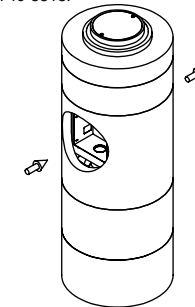

**ASSEMBLED VIEW**

SP

VortSentry Model	Manhole Diameter (ID)		Total Treatment Flow Rate		Typical Total Distance Rim to Outside Bottom		Typical Distance Rim to Invert		Typical Depth Below Invert (Inside)		Approximate Minimum Distance Rim to Invert (See Note 8)		Maximum Pipe Diameter (ID)	
	ft	mm	cfs	l/s	ft	m	ft	m	ft	mm	ft	m	in	mm
HS48	4	1200	1.20	34.0	13.50	4.11	6.00	1.83	7.00	660	4.00	1.22	24	600
HS72	6	1800	3.70	104.8	16.26	4.96	6.75	2.06	8.84	890	5.09	1.55	36	900
HS96	8	2400	8.10	229.4	20.92	6.38	8.50	2.59	11.59	890	6.17	1.88	48	1200

**TYPICAL DETAIL WITH SIZING TABLE**  
**STORMWATER TREATMENT SYSTEM**  
**VORTSENTRY® HS** US PATENT PENDING



contechstormwater.com

SCALE: NONE
DRAWN: NDG
CHECKED: GWB
FILE NAME: VSHSTYPTBL
DATE: 10/27/06

**FOR INFORMATIONAL PURPOSES ONLY - NOT INTENDED FOR CONSTRUCTION**